

# **Confidential Report**

Our Ref: 27/06362A/01/24







Client:

Wira House, West Park Ring Road, Leeds, LS16 6QL, UK.

Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

Date: 19 February 2024

Our Ref: 27/06362A/01/24

Your Ref: ---

Page: 1 of 13

Camira Fabrics Ltd

The Watermill Wheatley Park Mirfield West Yorkshire WF14 8HE

Job Title: Fire Classification Test on One Sample of Fabric

Clients Order Ref: 83A25513

Date of Receipt: 23 January 2024

Description of Sample: One sample of fabric, referenced;

Reference: RePlay Zero Batch: 537736 Colour: Move

Work Requested: We were asked to make the following test(s):

BS EN 13501-1, tested adhered

- subcontracted test, UKAS accredited
- \*\* subcontracted test, EN ISO/IEC 17025 accredited
- \*\*\* not UKAS accredited





Note: This report relates only to the items tested.



Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

Date: 19 February 2024

Our Ref: 27/06362A/01/24

Your Ref:

Page: 2 of 13

**Client: Camira Fabrics Ltd** 

# **Product Sample Description Sheet**

General description		RePlay Zero
Product reference of composite		-
Name of manufacturer of composite		BTTG Supplied
Thickness of composite		-
	Generic type	RePlay Zero – woven polyester fabric
	Product reference	RePlay Zero
	Name of manufacturer	Camira Fabrics
	Thickness	0.9mm (nominal)
Surface	Density / weight per unit area	380 gsm
	Colour reference	Move 21
	Trade name of flame retardant	N/A
	Generic type of flame retardant	N/A
	Amount of flame retardant	N/A
	Generic type	Adhered test: BTTG provided PVA
	Product reference	
	Name of manufacturer	
	Colour reference	
Adhesive	Application rate / thickness	
Adriesive	Application method	
	Trade name of flame retardant	
	Generic type of flame retardant	
	Amount of flame retardant	
	Curing process	
	Generic type	Adhered test: BTTG provided Gypsum Plasterboard
	Product reference	
	Name of manufacturer	
Substrate	Thickness	
	Density / weight per unit area	
	Colour reference	
	Trade name of flame retardant	
	Generic type of flame retardant	
	Amount of flame retardant	
Brief description of manufacturing process		
Additional Information		







Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

Date: 19 February 2024

Our Ref: 27/06362A/01/24

Your Ref: ---

Page: 3 of 13

Client: Camira Fabrics Ltd

# FIRE TESTS ACCORDING TO BS EN ISO 11925-2:2020

Reaction to fire tests – Ignitability of building products subjected to direct impingement of flame – Part 2 Single-flame source test.

Date of Test: 14/02/2024

# **Conditioning**

Test specimens and filter paper conditioned as described in BS EN 13238:2010.

# **Mounting Method**

Each specimen was mounted using the following conditions:

Method of Mounting/Fixing: Adhered

Test Substrate (as specified in (BS EN 13238): 12.5mm Gypsum Pasterboard (EN 520)

Adhesive (if applicable): PVA







Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

Date: 19 February 2024

Our Ref: 27/06362A/01/24

Your Ref: ---

Page: 4 of 13

Client: Camira Fabrics Ltd

#### **Procedure**

The sample was tested in accordance with BS EN ISO 11925-2:2020.

Three length and three width specimens were prepared in accordance with the above standard. Specified filter paper was placed beneath the specimen holder and replaced between tests.

The specimens were mounted vertically in the specimen holder so that one end and both sides were enclosed with the exposed end 30mm from the end of the frame. The burner was inclined at an angle of 45°.

The flame height was set at 20 mm with the flame impinging on the specimen for 30 seconds on the centre line, 40 mm above the bottom edge.

A marker was placed 150 mm above the upper end of the burner and the time recorded when the flame tip reached the marker, if applicable. The following parameters were also recorded:-

- 1. If ignition occurs
- 2. Presence of flaming debris, if applicable
- 3. Ignition of the filter paper, if applicable







Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

Date: 19 February 2024

Our Ref: 27/06362A/01/24

Your Ref: ---

Page: 5 of 13

Client: Camira Fabrics Ltd

# **Duration of test**

For a flame application time of 30 seconds, the total test duration is 60 seconds after application of the flame.

# **Classification Criteria**

The samples were classified according to BS EN 13501-1:2018 Fire classification of Construction Products and Building Elements: Part 1: Classification using Test Data from Reaction to Fire Tests.

For construction products excluding floorings to meet the performance criteria taken from Table 1:

Classification	Classification Criteria (mean values)	
E	Fs ≤ 150mm within 20 seconds	
F	Fails Class E	

Classification	Classification criteria for flaming droplets
	5 1
None	Pass = no ignition of paper
d-2	Fail = Ignition of paper







Page:

Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

Date: 19 February 2024

Our Ref: 27/06362A/01/24 Your Ref: ---

6 of 13

Client: Camira Fabrics Ltd

# **Results**

The test results relate to the behaviour of the test specimens of a material under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire hazard of the material in use.

Specimen			Tip of flame reaches 150mm		Flaming droplets	
		Ignition (Yes or No)	Yes or No	Time taken (s)	Yes or No	Ignition of Filter paper (Yes or No)
	1	Yes	No	N/A	No	No
Machine Direction	Machine Direction 2	Yes	No	N/A	No	No
3		Yes	No	N/A	No	No
Across Machine Direction	1	Yes	No	N/A	No	No
	2	Yes	No	N/A	No	No
	3	Yes	No	N/A	No	No

# Note

Sample was tested as an essentially flat product. A surface exposure was carried out only.







Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

Date: 19 February 2024


Our Ref: 27/06362A/01/24

Your Ref:

7 of 13 Page:

**Client: Camira Fabrics Ltd** 

# Photograph of BS EN 13823 Specimen

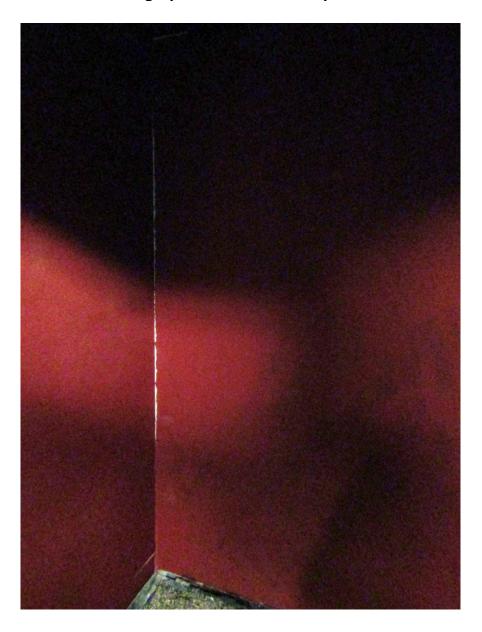







Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

Date: 19 February 2024

Our Ref: 27/06362A/01/24

Your Ref: ---

Page: 8 of 13

Client: Camira Fabrics Ltd

#### **FIRE TESTS ACCORDING TO BS EN 13823:2020+A1:2022**

Reaction to fire tests for Building Products - Building Products excluding floorings exposed to the thermal attack by a single burning item.

Classified According to BS EN 13501-1:2018

Date of Test: 14/02/2024

# **Conditioning**

The specimens were conditioned in accordance with BS EN 13238:2010.

# **Principle**

Test specimens, consisting of two vertical wings forming a right-angled corner, is exposed to the flames of a burner placed at the bottom of that corner. The flames are obtained by the combustion of propane gas, injected through a sandbox to give a heat output of 30.7±2.0kW.

The performance of the test specimen is evaluated over a period of 20 minutes. The performance requirements are: heat production, smoke production, lateral flame spread and falling flaming droplets and particles.

The heat production is measured by use of oxygen calorimeter that uses the principle that the amount of oxygen consumed in a fire is proportional to the amount of heat produced. The smoke production is measured by use of a light attenuation instrument installed in the exhaust duct alongside the sampling equipment used to measure the heat release. Visual observations are made of the horizontal flame spread and falling of flaming droplets and particles.







Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

Date: 19 February 2024

Our Ref: 27/06362A/01/24

Your Ref:

Page: 9 of 13

Client: **Camira Fabrics Ltd** 

# **Mounting Method**

Each specimen was mounted using the following conditions:

Method of Mounting/Fixing: Adhered

Test Substrate (as specified in (BS EN 13238): 12.5mm Gypsum Pasterboard (EN 520)

Adhesive (if applicable): **PVA** Specimen Consisted of Horizontal Joint: No Specimen Consisted of Vertical Joint: Nο

#### **Procedure**

The test was carried out in accordance with BS EN 13823:2020+A1:2022.

Each specimen was placed in the trolley as per the instructions given and placed underneath the hood in the testing chamber. The volume flow of the exhaust was set to 0.60±0.05 m<sup>3</sup>/s and maintained at this throughout the test period.

The temperatures in the exhaust hood and the ambient temperature should be within 4°C with the ambient temperature being within 20±10°C. The other pre-test conditions of ambient pressure and ambient relative humidity were also recorded.

The recording of baseline data is started at 0 s. At 120 s the auxiliary burner is ignited and the propane mass flow adjusted to the specified flow before 150 s, this flow to be kept constant throughout the test.

With the pre-test conditions met, the propane supply is switched from the auxiliary burner to the main burner at 300 s.

The burning behaviour of the specimen was recorded both automatically and visually over a period of 1,260 s from when the main burner was ignited.

At 1560 s the gas supply was terminated along with the automatic recording of the data. The conditions at the end of the test were recorded at least one minute after any remaining combustion has been totally extinguished.

The individual pre-test and baseline conditions, apparatus specifications, test validity criteria, burner details was found to be within specified parameters. The graphs of HRR, HRR(30), THR, FIGRA, SPR, SPR(60), TSP and SMOGRA are found below with the results and classification.







Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

19 February 2024 Date:

Our Ref: 27/06362A/01/24

Your Ref:

Page: 10 of 13

**Client: Camira Fabrics Ltd** 

# **Classification Criteria**

The samples were classified according to BS EN 13501:2018 Fire classification of Construction Products and Building Elements: Part 1: Classification using Test Data from Reaction to Fire Tests.

For construction products excluding floorings the classes are:

Classification	Classification Criteria (mean values)				
Classification	FIGRA <sub>0.2MJ</sub> (W/s) FIGRA <sub>0.4MJ</sub> (W/s)		LFS	THR <sub>600s</sub> (MJ)	
A2	≤120	N/A	Edge of specimen	≤7.5	
В	≤120	N/A	Edge of specimen	≤7.5	
С	N/A	≤250	Edge of specimen	≤15	
D	N/A	≤750	No requirement	No requirement	

To meet classification A2 the sample also has to meet the requirements of either BS EN ISO 1182 or BS EN ISO 1716.

To meet classification B, C and D the sample also has to meet the requirements of BS EN ISO 11925-2.

Additional Classifications - Smoke and Flaming droplets/particles

Classification	Classification Criteria (mean values)			
Classification	SMOGRA (m <sup>2</sup> /s <sup>2</sup> )	TSP <sub>600s</sub> (m <sup>2</sup> )		
s1	≤30	≤50		
s2	≤180	≤200		
s3	Not s1 or s2	Not s1 or s2		
d0	No flaming droplets/particles within 600seconds			
d1	No flaming droplets/particles persisting longer than 10 seconds			
uı	within 600 seconds			
d2	Not d0 or d1			







Page:

Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

Date: 19 February 2024

Our Ref: 27/06362A/01/24 Your Ref: ---

11 of 13

Client: Camira Fabrics Ltd

# **Results**

Classification criteria	Specimen			Mean	Class	
Classification criteria	1	2	3			
FIGRA <sub>0.2MJ</sub> (W/s)	0.0	0.0	0.0	0.0		
FIGRA <sub>0.4MJ</sub> (W/s)	0.0	0.0	0.0	0.0	ь	
THR <sub>600s</sub> (MJ)	0.3	0.4	0.2	0.3	В	
LFS to edge (yes or no)	No	No	No	No		
SMOGRA (m <sup>2</sup> /s <sup>2</sup> )	0.0	0.0	0.0	0.0	-1	
TSP <sub>600s</sub> (m <sup>2</sup> )	27.6	32.9	34.0	31.5	31.5 s1	
FDP flaming ≤ 10 s (yes or no)	No	No	No	No	40	
FDP flaming > 10 s (yes or no)	No	No	No	No	d0	

# **Note**

The test results relate to the behaviour of the test specimen of a product under the particular conditions of the test; they are not intended to be the sole criteria for assessing the potential fire hazard of the product in use.

Test BS EN 13823:2020+A1:2022 is accredited under our flexible scope policy.

# **Observations**

On all specimens, at around 10 seconds into the test, the material splits, and melts away from the burner flame.







Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

19 February 2024 Date:

Our Ref: 27/06362A/01/24

Your Ref:

Page: 12 of 13

**Client: Camira Fabrics Ltd** 

#### Comment

The results meet the requirements of a Class B, s1, d0, as specified in BS EN 13501-1:2018.

Where required to make a judgement to any pass/fail criteria an estimation of uncertainty of measurement has been taken into account. Under our Policy we have used a non-binary decision rule.

See our decision rules Policy (https://www.bttg.co.uk/about-us/decision-rules-policy/) for further information.

...... G Harvey (Mr), Laboratory Technician Reported by:.....

..... A Shute, Section Leader

Enquiries concerning this report should be addressed to Customer Services.







Telephone: +44 (0) 113 259 1999 Email: onestopshop@bttg.co.uk

Website: www.bttg.co.uk

Date: 19 February 2024

Our Ref: 27/06362A/01/24

Your Ref: ---

Page: 13 of 13

Client: Camira Fabrics Ltd

# **Uncertainty Budget**

The uncertainty budget for BS EN 13501-1:2018 was determined as follows:-

#### BS EN ISO 11925-2:2020

±2 seconds for time recorded removal of flame and terminate test

#### BS EN 13823:2020+A1:2022

FIGRA 0.2MJ	±15%
FIGRA 0.4MJ	±15%
THR 600s	±10%
SMOGRA	±15%
TSP 600s	+20%



